
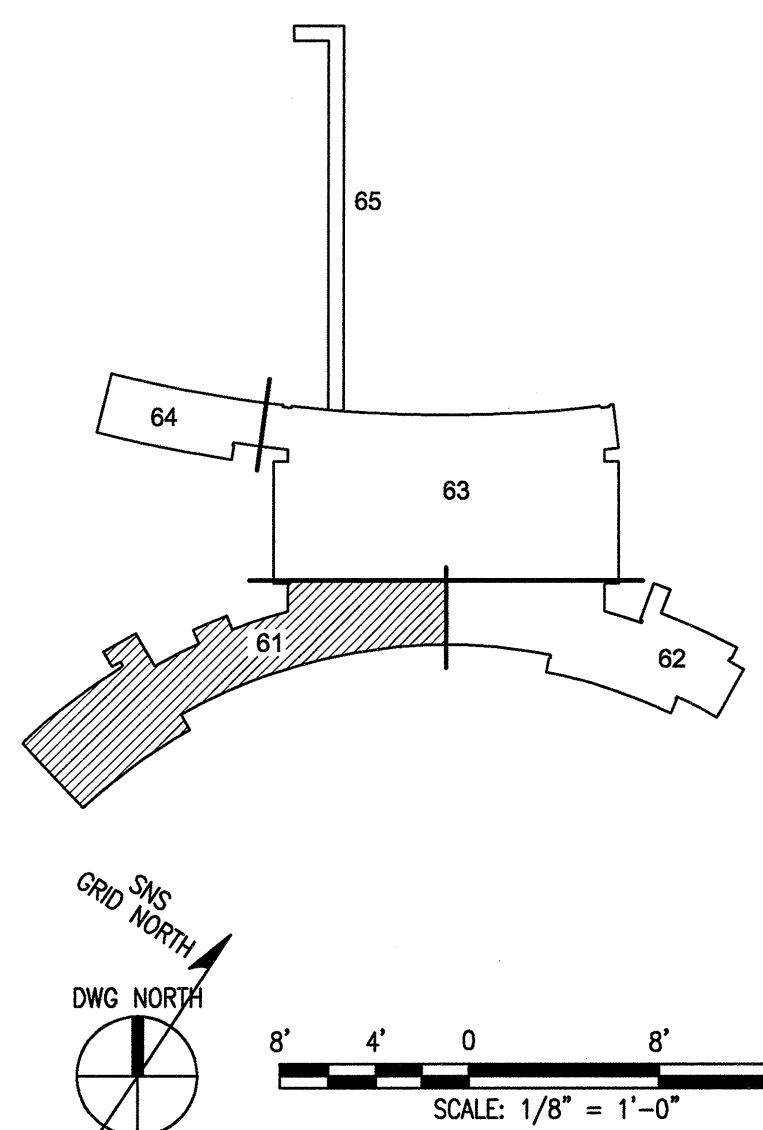


GENERAL NOTES:


1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E.0.00.01
2. CABLE TRAY FOR VOICE/DATA WIRING ONLY. MOUNT BOTTOM OF TRAY 1'-0" ABOVE FINISHED CEILING.
3. PROVIDE SLEEVED OPENING FOR ALL TELEPHONE ROOM FLOOR PENETRATIONS. REFER TO DWG EB.20.40 FOR CONDUIT QTY AND SIZE AND DWG EB.10.47 DETAIL 5.

KEYNOTES:

N001 CONNECT P.A. SPEAKERS TO AMPLIFIER 81-PAA3 LOCATED IN TELEPHONE ROOM 81-4-76.

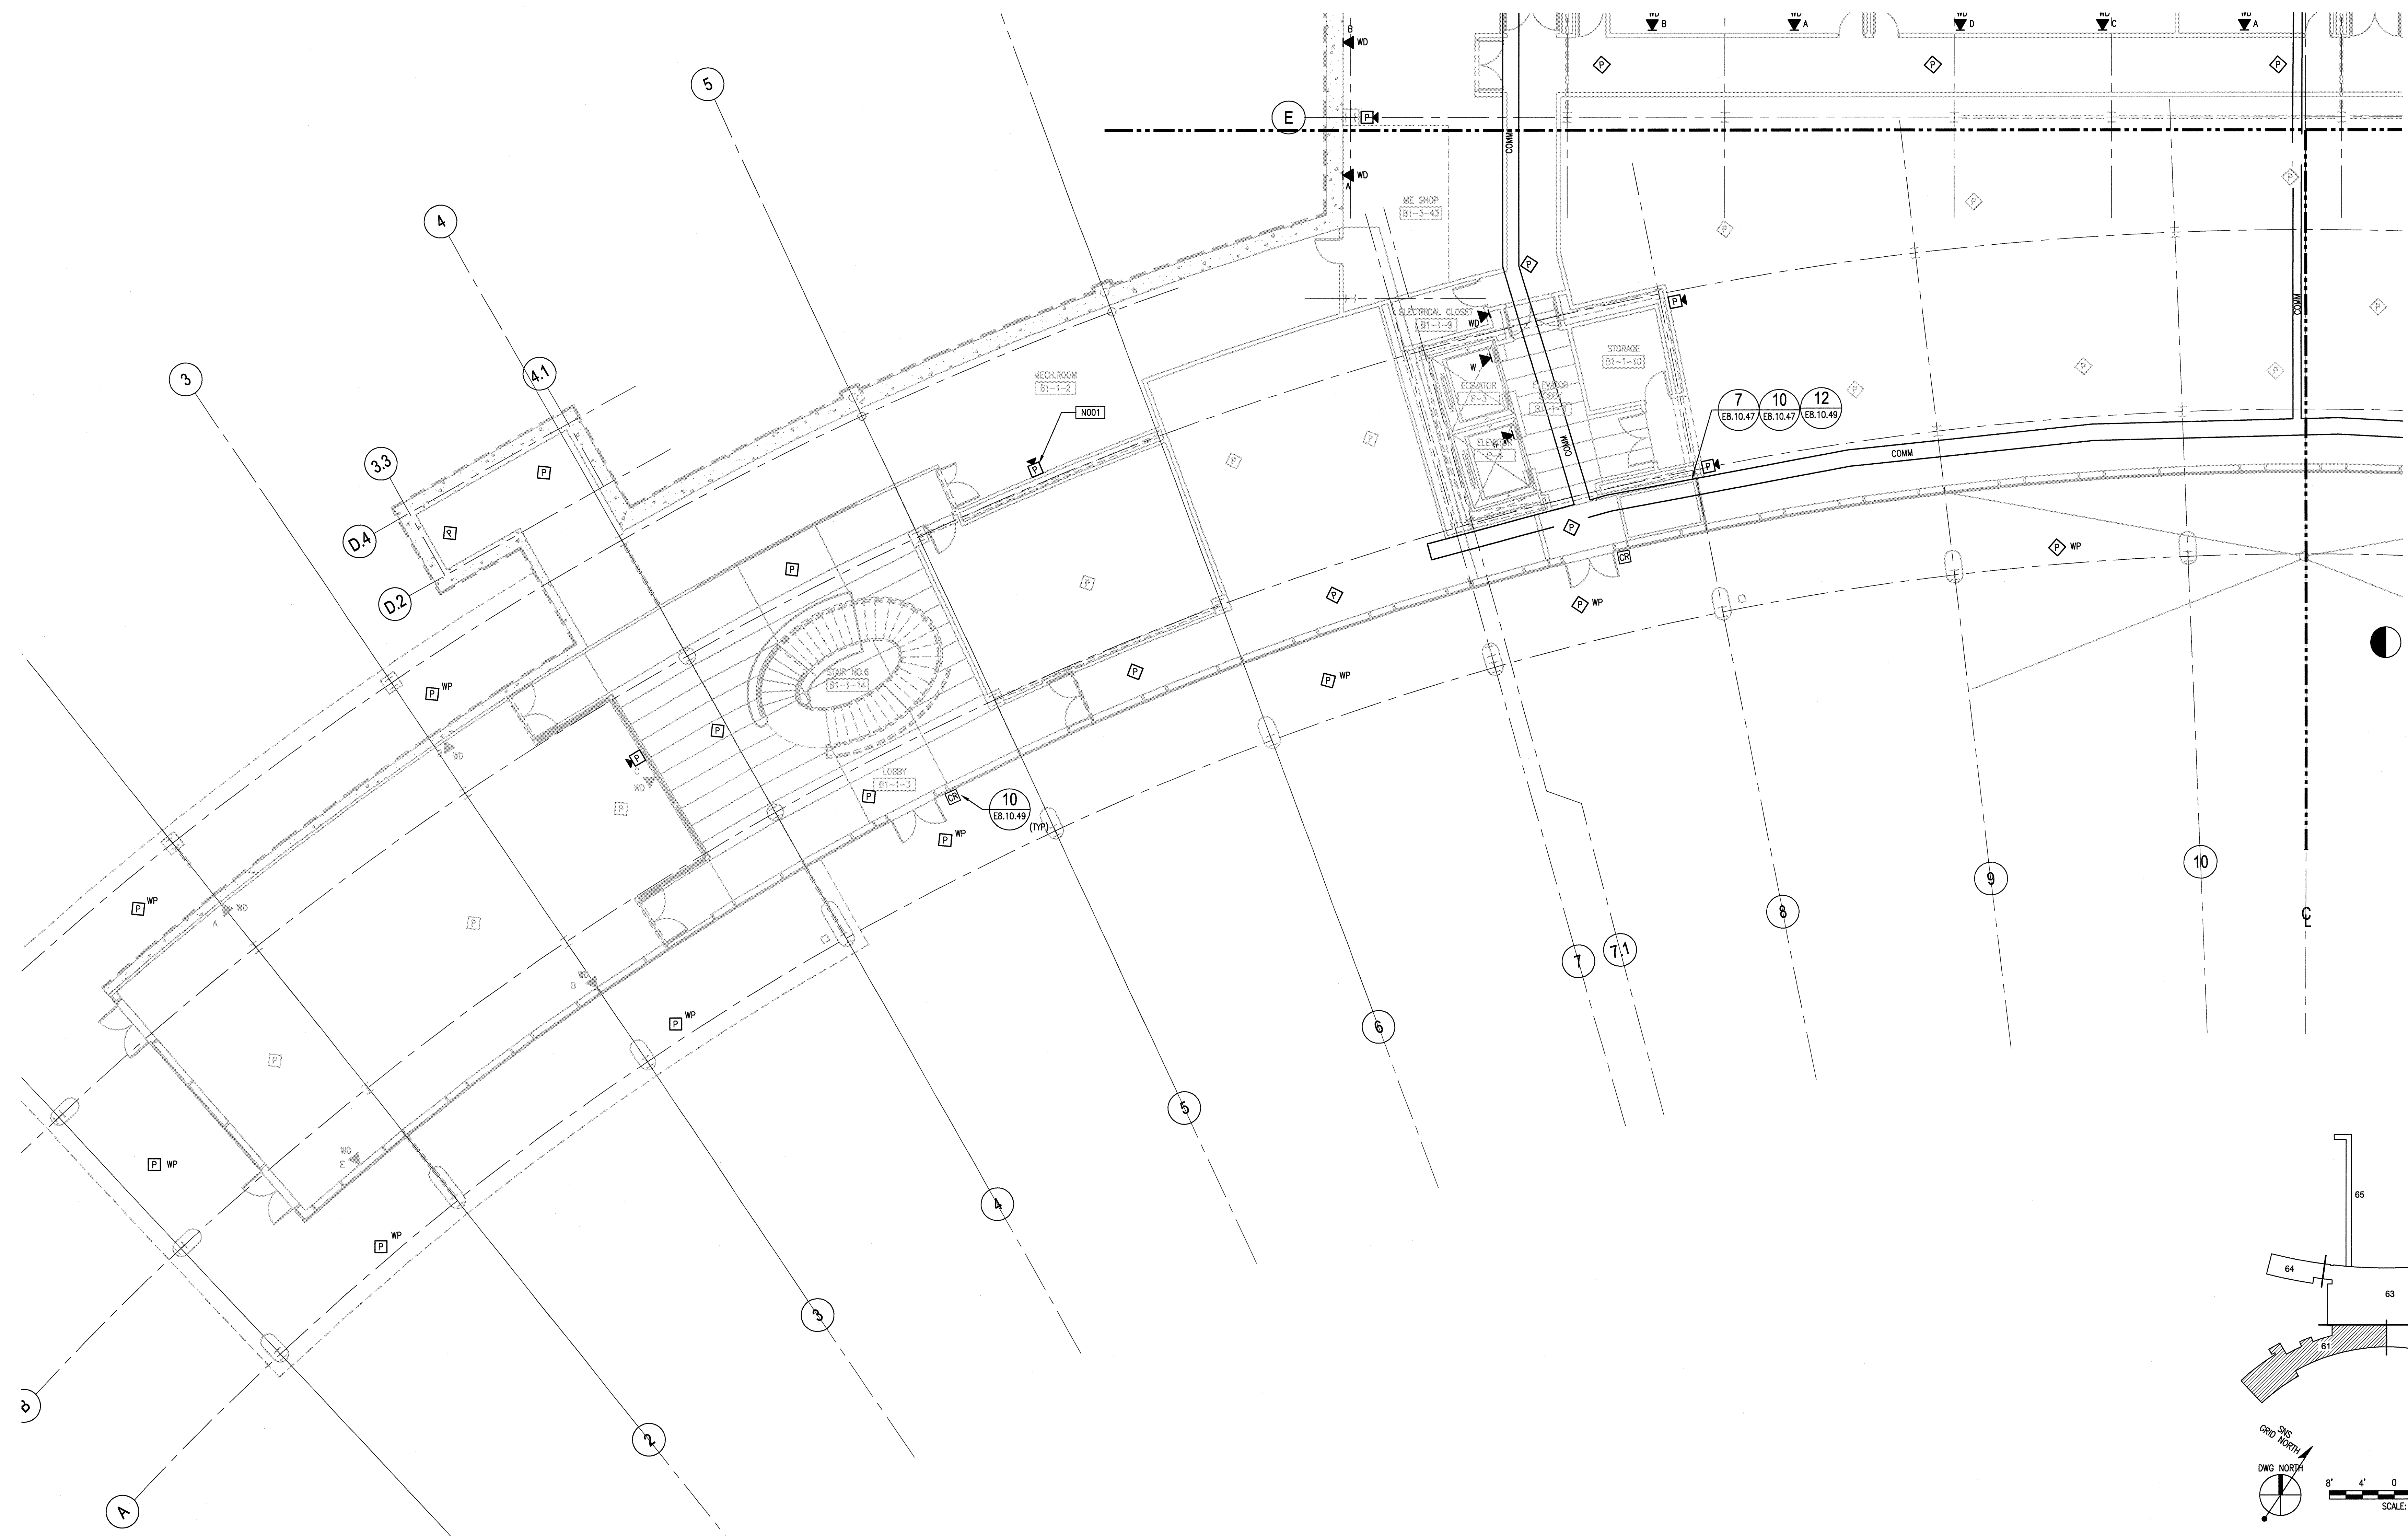


108031400-E8E-8600-A101

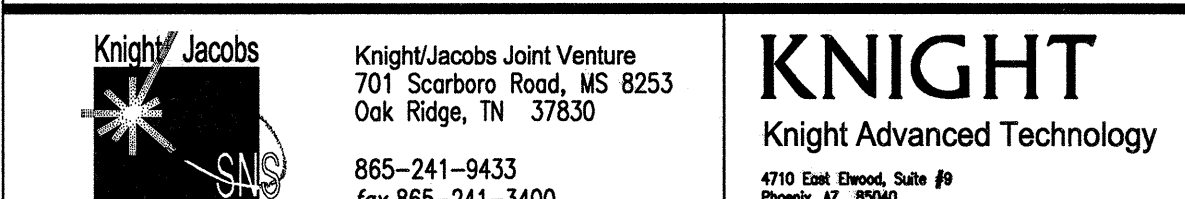


 Oak Ridge National Laboratory
managed for the DEPARTMENT OF ENERGY under
U.S. GOVERNMENT contract DE-AC05-00OR22725
UT-BATTELLE, LLC, c Oak Ridge, Tennessee

PROJECT NAME:	
SPALLATION NEUTRON SOURCE	
CENTRAL LAB AND OFFICE BUILDING	
ELECTRICAL COMMUNICATIONS PLAN	
LEVEL B1, SECTOR 61	

DSN	L. PACHECO	5/15/06
DRW	CAD	5/15/06
CHK	V. STEFFEN	5/15/06
DEPT		
PE	C.GARREN	10/1/06
PJ	J. STELLERN	8/21/06
REQ		
UTB	J.LAWSON	10/8/06

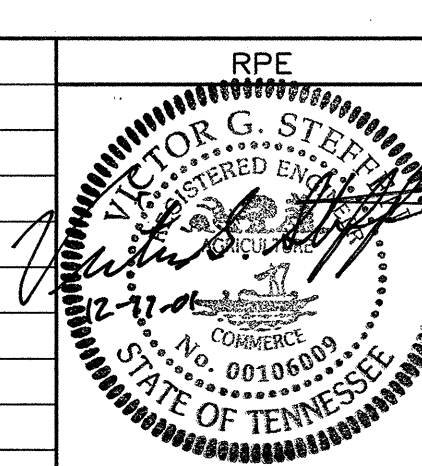[illegible]

<p>NO REPRESENTATION OR WARRANTY, EXPRESSED OR IMPLIED, IS MADE AS TO THE ACCURACY, COMPLETENESS OR USEFULNESS OF THE INFORMATION OR STATEMENTS CONTAINED IN THESE DRAWINGS, OR THE USE OR DISCLOSURE OF ANY INFORMATION, APPARATUS, METHOD, OR PROCESS ILLUSTRATED IN THESE DRAWINGS MAY NOT IMPROVE PRIOR RESULTS OF OTHERS. NO LIABILITY IS ASSUMED WITH RESPECT TO THE USE OF, OR ANY DAMAGES RESULTING FROM THE USE OF INFORMATION, APPARATUS, OR PROCESS ILLUSTRATED OR DISCLOSED IN THESE DRAWINGS. DRAWINGS MADE AVAILABLE FOR INFORMATION ONLY ARE NOT TO BE USED FOR OTHER PURPOSES AND ARE TO BE RETURNED UPON REQUEST OF THE FORMING CONTRACTOR.</p>	<p>NUMBER OF SECTION OR DETAIL</p>  <p>DRAWING ON SHEET SECTION OR DETAIL IS CHANGED OR TAKEN</p>	<p>THIS DOCUMENT CONTROLLED BY</p>
		<p>CHANGE CONTROL SYSTEM 4</p>
	<p><u>SECTION AND DETAIL KEY</u></p>	<p>ENGINEERING PROCEDURE <u>SNS-ENG-00</u></p>